



## Battery Tester

# SBT300/60

Replace above contents to below

High-precision measurement: Voltage:  $\pm 0.01\%$  of reading  $\pm 3$  digits,

Resistance:  $\pm 0.4\%$  of reading  $\pm 5$  digits

High resolution display: Voltage up to  $10\mu V$ , Resistance up to  $0.1\mu \Omega$

AC 4-terminal testing method

Wide resistance range:  $3m\Omega \sim 3000\Omega$

Voltage measurement up to 300V(SBT300), 60V(SBT60)

10ms response time + 20ms sampling time

Storage function, Comparator function, comprehensive judgement results output,

Two setting methods, Manual comparison, Four kinds of beeping, Static function,

Correction function, Analog output function



SUITA Electric Co. Ltd

© 2017~2023 SUITA ELECTRIC CORPORATION all rights reserved

Global HQ Office: Unit 1608, 16/F, One Harbourfront,

18 Tak Fung Street, Hung Hom, Kowloon, Hong Kong

TEL: +852 2605 6955 / FAX: +852 2605 6933

Japan Office: 8-65 Higashiotabichō, Suita City, Osaka 564-0033

TEL: +81 06-6383-1700 / FAX: +81 06-6383-1701

Website: <http://suitaelectric.com>

Email: [sales@suitaelectric.com](mailto:sales@suitaelectric.com)



Suita Electric Website

SUITA ELECTRIC Corporation, headquartered in Suita, Osaka, Japan, is a leading provider of high-end equipment with a focus on quality and innovation. Drawing from years of dedicated research and development, our company delivers top-notch products that span various industries, including electric power, energy resources, transportation, automobiles, and telecommunications. Our advanced, reliable, and comprehensive test and measurement solutions are sought after by R&D companies and manufacturers. Through systematic approaches, we address the intricate demands of our customers, actively contributing to the continuous development and updating of global industries.

The SBT60/300 battery tester is a highly precise and high-resolution instrument widely utilized for testing various batteries, including lithium batteries for mobile phones, storage batteries, and power batteries. Using the AC four-terminal test method, it precisely measures the internal resistance and voltage of the battery. The built-in comparator function automatically verifies whether the battery parameters meet the standard, allowing for the calculation of the pass rate. This tester is well-suited for testing and sorting a variety of batteries.



# Measurement Object And Purpose

- Be used for high voltage battery pack inspection
- Be used for battery module inspection
- Be used for the inspection of large(low impedance) components
- Be used for high speed mass production inspection of button batteries
- Be used for fuel battery pack measurement
- Be used for battery research, development and measurement
- Be suitable for high speed mass production inspection of small battery pack of mobile phone/ portable electronic products
- Be suitable for high speed mass production inspection of small components

can be checked through screen display, beeping, external I/O output. The judgment results of both parties can be checked through image display at the same time.

- **Comprehensive judgment results output**

In addition to the respective judgment results of resistance and voltage, the comprehensive judgment results can be output to the external I/O.

- **Two setting methods**

The following 2 modes can be set. Hi/Lo is set according to the respective upper and lower limits and the deviation (%) of any standard value.

- **Manual comparison**

There are manual comparison method and automatic comparison method. The instrument adopts automatic comparison method by default. Only when EXT I/O is ON in manual comparison mode , the results of output comparator is suitable for pedal switch, PLC control and other occasions.

- **Four kinds of beeping**

Beeper settings include OFF, HL, IN, BT1 and BT2 modes. In BT1 and BT2 modes, IN or Hi/Lo can be set to different beeps.

## Statistic function

Calculate statistical indicators according to the measurement results, draw the normal distribution map, observe the normal distribution of the measurement results.

## Correcting function

Be used to compensate the offset voltage or gain drift of the internal circuit of the instrument to improve the test precision. There are automatic calibration and manual calibration. In the automatic correction mode, correction shall be conducted automatically once every 30 minutes; In manual mode, correction can be performed manually through Ext I/O and communication commands. During calibration, the measurement processing shall be suspended and the instrument shall be automatically corrected by default.

## Analog output function

With SBT60/300 battery tester, analog output of the resistance measurement value can be conducted. By connecting the analog output quantity to the recorder, the change of the resistance value can be recorded. It is convenient to use the data acquisition instrument for long-term recording measurement and fuel battery evaluation.

## Functional Advantages And Features

### AC four-terminal test method

The impedance measurement adopts AC four-terminal method, which is not affected by the wiring impedance of the test line.

### High-precision measurement

Resistance:  $\pm 0.4\%$ rdg. $\pm 5$ dgt.

Voltage:  $\pm 0.01\%$ rdg. $\pm 3$ dgt.

### High resolution display

Resistance:  $0.1\mu\Omega$

Voltage:  $10\mu V$

### Storage function


The measurement results (data) can be stored in the instrument memory or U flash disk in CSV format or MAT format, and the data stored in the memory can also be exported to U flash disk, so that the measurement results of the corresponding time can be viewed at any time.

### Comparator function


- **Resistance and voltage can be checked simultaneously**

With the independent comparison functions of resistance and voltage, Pass/Hi/IN/Lo can be judged. The results

# Product Overview

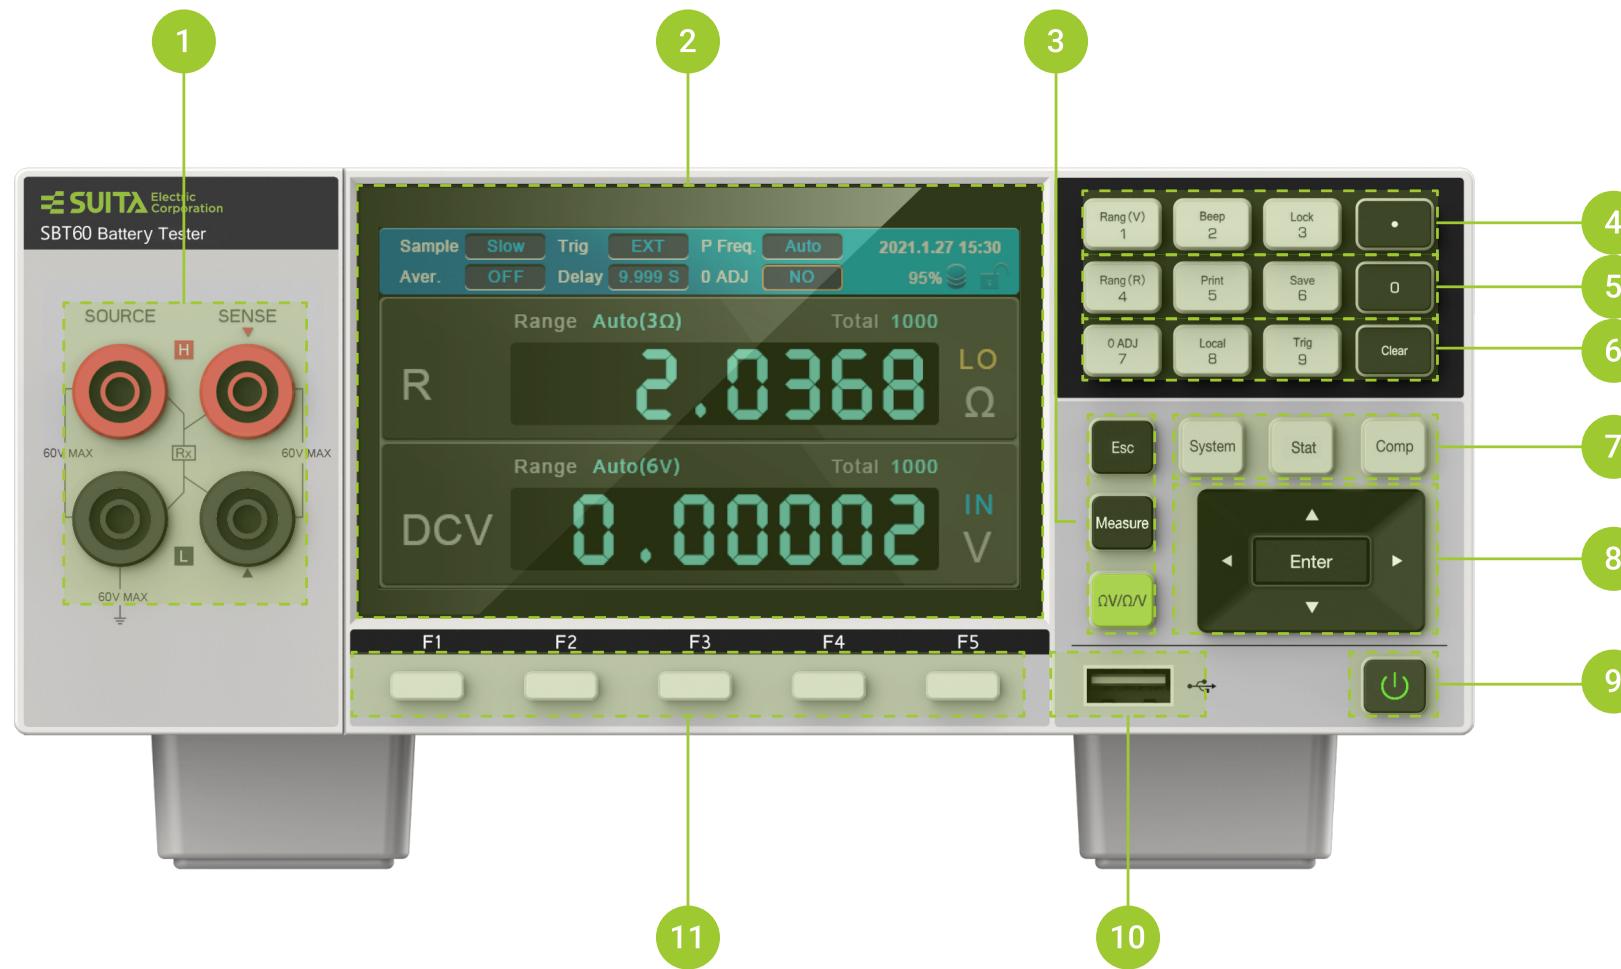

- |   |  |    |   |
|---|--|----|---|
| 1 | Input port   | 7  | System setting menu key/statistics menu key/<br>Compare function menu key |
| 2 | Display  | 8  | On-off key  |
| 3 | Cancel or Back key/Measurement function menu key/measurement mode switch key | 9  | Confirm key and direction selection key                                   |
| 4 | Voltage range key/volume key/locking key/0key                                | 10 | USB interface   |
| 5 | Resistance range key/print shortcut key/save setting key/0 key               | 11 | Softkey   |
| 6 | Reset key/cut-off remote control key/manual trigger key/Clear key            |    |   |

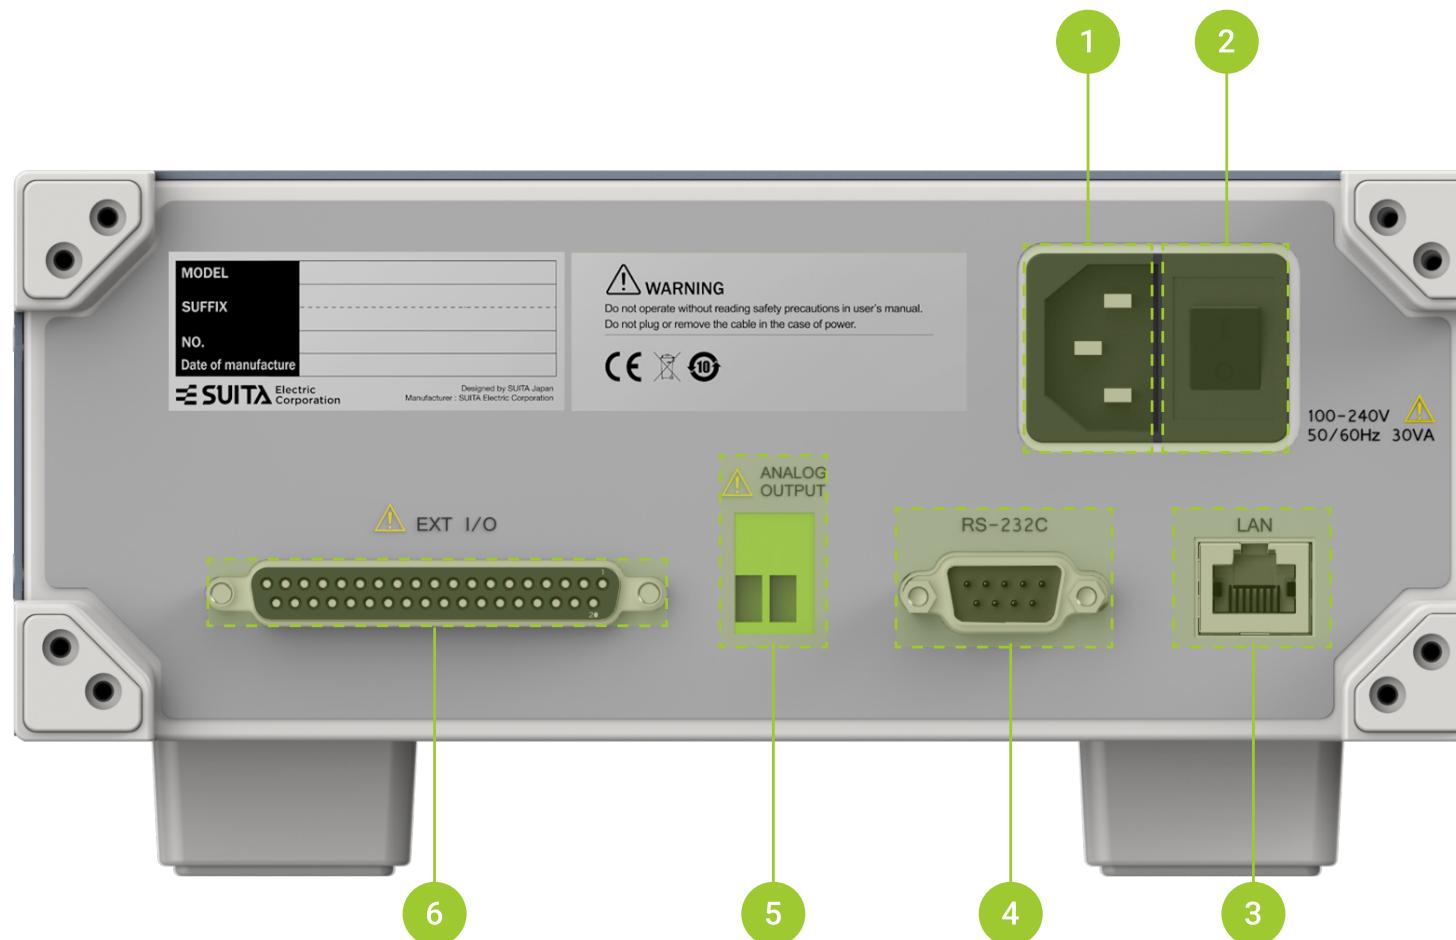

- |   |                               |   |                         |
|---|-------------------------------|---|-------------------------|
| 1 | Electric power line interface | 7 | RS-232C interface       |
| 2 | Power switch                  | 8 | Analog output interface |
| 3 | Ethernet interface            | 9 | EXT I/O interface       |

# Specification Parameters

## Basic parameters

Item	Specification
Measuring items	Resistance, voltage
Test method	AC four-terminal test method
Functionalities	$\Omega V/\Omega/V$
Voltage range	SBT60:6V/60V SBT300:6V/60V/300V
Resistance range	3m $\Omega$ /30m $\Omega$ /300 m $\Omega$ / 3 $\Omega$ /30 $\Omega$ /300 $\Omega$ /3000 $\Omega$
Nominal voltage	Rated input voltage: DC $\pm$ 60V(SBT60), DC $\pm$ 300V(SBT300) Maximum rated voltage to ground: DC $\pm$ 60V(SBT60), DC $\pm$ 300V(SBT300)
Input impedance	DC input impedance 3M $\Omega$
Sample rate	FAST/MEDIUM/SLOW
Response time	Measurement response time: about 10ms
Total measurement time	Response time +sampling time
Zero set	Zero range: -1000~1000 counting values(resistance and voltage are the same), the zero range can be less than or equal to $\pm$ 1000 dgt.
Trigger	Internal trigger/external trigger/manual trigger
Mean Average	On /OFF, average number of time: 2~16 times
Delays	On /OFF, delay time: 0~9.999 seconds
Statistics	On /OFF/ reset, operation content: maximum value, minimum value, average value, sampling standard deviation, parent standard deviation, process capability index, etc.
Comparator	Compare mode: AUTO/MANUAL, Beeper mode: OFF/HL/IN/BT1/BT2, Upper and lower resistance limits: 0~3000 $\Omega$ , Upper and lower voltage limits: 0~60V(SBT60)/0~300V(SBT300), Resistance reference value: 0~3000 $\Omega$ , Voltage reference value: 0~60V(SBT60)/0~300V(SBT300), Percentage: 0.00%~99.99%
Measurement output	The measured value can be transmitted to the computer in real time through RS- 232C or LAN port
Memory	Maximum storage space 2.8G
Configuration storage and reading	Maximum storage of 200 groups, measurement configuration items: measurement function, resistance range, voltage range, delay, delay time, sampling rate, average value, average number, self-correction, trigger mode, power frequency, comparator, statistical operation function, judgment beeping of comparator, storage

## Sampling time

Functionalities		Fast	Medium	Slow
$\Omega V$	(50Hz) (60Hz)	40ms	80ms	320ms
$\Omega$	(50Hz)	20ms	40ms	200ms
	(60Hz)			
$V$	(50Hz) (60Hz)	20ms	40ms	200ms

## Measurement range and precision

### Precision guarantee condition

Temperature and humidity range:  $23 \pm 5^\circ\text{C}$ , below 80%rh (no condensation)

Zero setting: after zero setting

Preheating time: above 30 minutes

Automatic correction: when the sampling rate is not slow, it shall be corrected automatically after preheating.

Temperature change is within  $\pm 2^\circ\text{C}$  after automatic correction.

### Precision

The overall error is jointly determined by the reading error of the measured value and the digital error of the measured range.

For example:

Standard value:  $1\Omega$ , measuring span:  $3\Omega$

Based on the table below, the reading error is  $\pm 0.4\%$  rdg, digital error is  $\pm 5\text{dgt}$ , and the reading error ( $\pm\%\text{rdg.}$ ) is  $1\Omega \times \pm 0.4\% = \pm 0.004\Omega$

Digital error ( $\pm\text{dgt.}$ ): the current minimum resolution is  $0.0001\Omega$  range, so  $\pm 5\text{dgt.} = \pm 0.0005\Omega$

The overall error: reading error + number error, namely  $\pm 0.0045\Omega$

Based on the calculation, relative to the standard value of  $1\Omega$ , the precision range of the instrument is  $0.9955 \sim 1.0045\Omega$ .

### Impedance measurement

Range	3mΩ	30mΩ	300mΩ
Maximum display value	3.1000mΩ	31.000mΩ	310.00mΩ
Resolution	0.1μΩ	1μΩ	10μΩ
Measure current *1	100mA	100mA	10mA
Measurement current frequency	$1\text{kHz} \pm 0.2\text{Hz}$		
Precision*2	$\pm 0.4\%\text{rdg.} \pm 10\text{dgt.}$		$\pm 0.4\%\text{rdg.} \pm 5\text{dgt.}$
Temperature factor	$(0.05\%\text{rdg.} \pm 1\text{dgt.})/\text{°C}$		$(\pm 0.05\%\text{rdg.} \pm 0.5\text{dgt.})/\text{°C}$
Open port voltage	25V peak		

### Impedance measurement

Range	3Ω	30Ω	300Ω	3000Ω
Maximum display value	3.1000Ω	31.000Ω	310.00Ω	3100.0Ω
Resolution	100μΩ	1mΩ	10mΩ	100mΩ
Measure current *1	1mA	100μA	10μA	10μA
Measurement current frequency	$1\text{kHz} \pm 0.2\text{Hz}$			
Precision*2	$\pm 0.4\%\text{rdg.} \pm 5\text{dgt.}$		$\pm 0.4\%\text{rdg.} \pm 5\text{dgt.}$	
Temperature factor	$(\pm 0.05\%\text{rdg.} \pm 1\text{dgt.})/\text{°C}$		$(\pm 0.05\%\text{rdg.} \pm 0.5\text{dgt.})/\text{°C}$	
Open port voltage	25V peak			10V peak

\*1: measurement current error is within  $\pm 10\%$

\*2: Add  $\pm 2\text{dgt.}$  for FAST and  $\pm 2\text{dgt.}$  for MEDIUM.

Add  $\pm 10\text{dgt.}$  for FAST and  $\pm 5\text{dgt.}$  for MEDIUM (3mΩ range)

## Voltage Measurement

Range	60V	300V (SBT300)
Maximum display value	±60.0000V	±300.000V
Resolution	100µV	1mV
	Display value 6V : Resolution: 10µV	
Precision	±0.01%rdg.±3dgt.	
Temperature coefficient*3	(±0.001%rdg.±0.3dgt.)/°C	

\*3: Add 2dgt for FAST and 2dgt for MEDIUM.

## External interface

Item	Specification
Analog Output	Screw terminal
Type A USB	Conform to USB Rev. 2.0 USB flash disk file format FAT32
EXT I/O	DB-37 (hole type)
RS-232	DB-7 (hole type), comply with EIA-574 (EIA- 232(RS-23) 9-pin type standard)

## General features

Item	Specification
Preheating time	About 30 minutes
Working environment	0°C~40°C, below 80%RH (no moisture condensation)
Storage environment	-10 °C ~50 °C, below 80%RH (no moisture condensation)
Operation place	Indoor
Working altitude	2,000m or below
Rated supply voltage	100~240VAC(±10%)
Rated power supply frequency	50/60Hz(±2%)
Maximum power consumption	35VA
Size	306mm*232mm*108.5mm
Weight	About 3kg

## Model and code

Name	Model No.	Instructions
Host	SBT60/300	Battery tester
Optional interface	/CE	Ethernet interface
	/DA	Analog output (D/A) interface
	/IO	EXT I/O interface
Optional components	BZ-1001	Zero setting panel
	BL-1001	Four-terminal test line (pin type)
	BL-1002	Four-terminal test line (clip type)